

FerryCHARGER QUESTIONNAIRE


Company: _____
 Contact person: _____
 Street: _____
 Zip code / city: _____
 Phone: _____
 Fax: _____
 e-Mail: _____ @ _____

All dimensions given are indicative values and not binding. They are recalculated in individual cases. Dimensions with a red frame must be filled out. They are decisive for the offer and should be as exactly as possible.

Regarding this drawing we reserve all rights. The drawing is for information only and will not be considered in the case of alterations. Copying of this document, giving it to others and use or communication of the contents thereof, are forbidden without expressive permission. Offenders are liable to the payment of damages. All rights are reserved in the event of issuing a patent or the entry of a registered pattern or design.

ST REF-No.	YOUR REF-No.
QUANTITY	
1. Quantity FerryCHARGER tower	_____ pieces
2. Quantity FerryCHARGER socket	_____ pieces
DELIVERY / WARRANTY	
3. Estimated time of order	_____
4. Estimated time of delivery FerryCHARGER tower (standard: 30 weeks, ExWork)	_____
5. Estimated time of delivery FerryCHARGER socket (standard: 24 weeks ExWork)	_____
6. Estimated time of Warranty (standard: 32 month from delivery or 24 months from commissioning)	_____
7. Place of delivery FerryCHARGER tower	_____
8. Place of delivery FerryCHARGER socket	_____
9. Ambient temperature	_____ °C up to _____ °C
TRANSMITTABLE POWER (current / voltage / 100% duty cycle)	
10. Low voltage	<input type="checkbox"/> 1600 A, 0.6/1 kV <input type="checkbox"/> 3000 A, 0.6/1 kV _____ A, 0.6/1 kV <input type="checkbox"/> AC <input type="checkbox"/> DC
Medium voltage	<input type="checkbox"/> 300 A, 6/10 (12) kV <input type="checkbox"/> 600 A, 6/10 (12) kV _____ A, _____ kV <input type="checkbox"/> AC <input type="checkbox"/> DC
FerryCHARGER SOCKET, Operating Voltage	
11. 1PH 230VAC/50Hz 16A L1/N/PE or preferable 3PH 400VAC/50Hz 16A L1/L2/L3/N/PE	Interface: Profinet
FerryCHARGER TOWER, Operating Voltage	
12. 3PH 400VAC/50Hz 35A L1/L2/L3/N/PE	Interface: Profinet
ATTACHMENTS	
13. _____ / <input type="checkbox"/> Terminal/quay layout plan	
REMARKS / NOTES	
14. _____	

Special applications on request

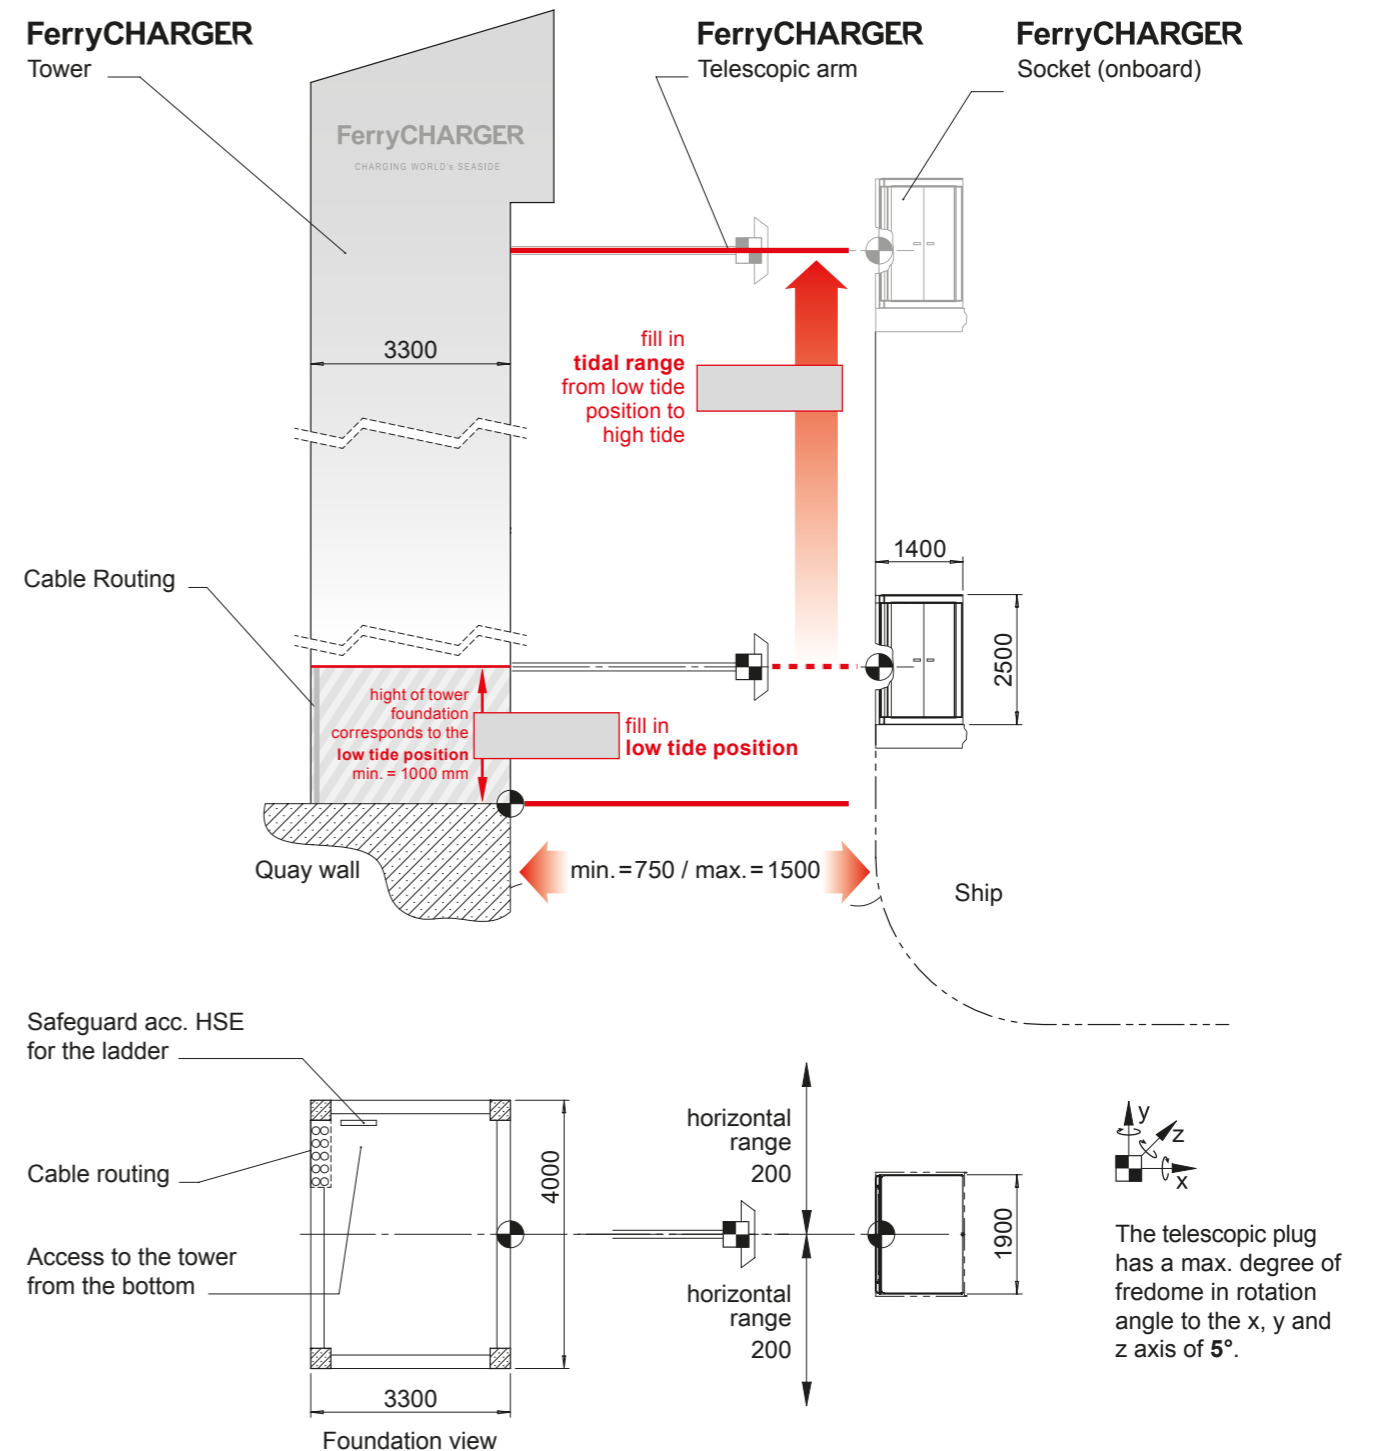

⊙ = Reference point: The reference point is determined by Stemmann-Technik and is decisive for the installation on ship and land.